



STATE OF KANSAS  
OFFICE OF THE FIRE MARSHAL

MARK PARKINSON    DAN McLAUGHLIN  
GOVERNOR            FIRE MARSHAL

700 SW Jackson, Suite 600  
Topeka, KS 66603-3714  
Voice: 785.296.3401  
Fax: 785.296.0151  
[www.accesskansas.org/firemarshal](http://www.accesskansas.org/firemarshal)

## MEMORANDUM

To: All Healthcare Facilities

Date: 11/5/2009

Effective January 1, 2010 we will be implementing a new process for conducting exit interviews with all healthcare facilities.

The Kansas State Fire Marshal's Office is sub-contracted through KDOA and KDHE to conduct inspections for Centers for Medicare and Medicaid (CMS). CMS is constantly reviewing and evaluating our reports, processes, and procedures for accuracy, timeliness, and overall compliance with their operations manuals.

We were recently informed by the State Agency that our inspection reports contain numerous grammatical and spelling errors which have started to impact our rating with CMS. The Kansas State Fire Marshal's Office is taking this feedback very seriously as we believe all inspection reports must be done professionally and as accurately as possible.

In an effort to improve, we are in the initial stages of putting a new process in place whereby all inspection reports will be reviewed for total accuracy prior to being given to the facility.

This new process will have NO effect on the facilities timeframe for submitting a plan of correction response to our office. However, it will affect how our field inspectors conduct their exit conference with the facility prior to leaving the facility.

After the inspection, the field inspector will type his/her report and will sit down with a facility representative to verbally go over all of the findings. The inspector will then submit the report to a designated KSFM quality assurance inspector for review. Once the report has been approved and finalized, a copy will be electronically submitted to the facility. The facility will have 10 calendar days from the date that the report was electronically submitted to submit their plan of correction response.

We are requesting that everyone please be patient as we go forward with these changes and please contact our office if you have any questions or concerns.

Thank You

Brenda McNorton  
Chief, Fire Prevention Division



STATE OF KANSAS  
OFFICE OF THE FIRE MARSHAL


MARK PARKINSON DAN McLAUGHLIN  
GOVERNOR FIRE MARSHAL

700 SW Jackson, Suite 600  
Topeka, KS 66603-3714  
Voice: 785.296.3401  
Fax: 785.296.0151  
www.accesskansas.org/firemarshal

# Five Minutes to Fire Safety

No. 2009-H4 November 5, 2009

## Topic: Natural Gas Generator Backup Fuel Source Letter Requirements

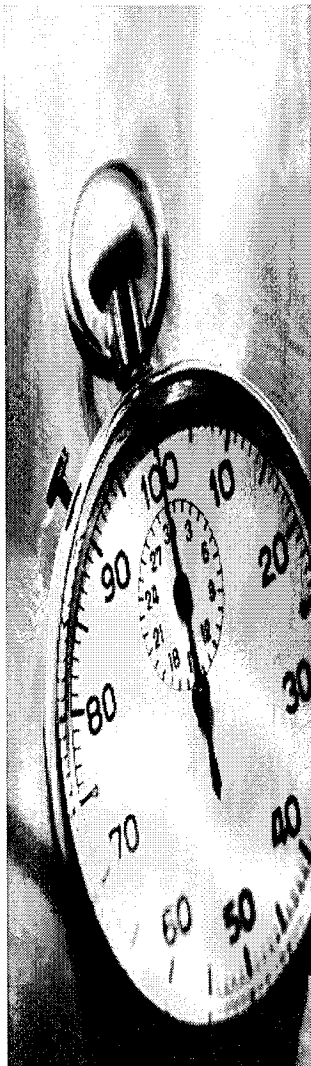

On May 29, 2009 CMS Central Office released initial information regarding Natural Gas Generator Backup Fuel Source Letter Requirements. We want to pass on to you some additional clarifications related to the backup fuel source for natural gas generators.

All nursing homes are required to have an on-site backup power source. If a facility uses a natural gas generator to provide backup power to LSC required systems (i.e., emergency lights, exit lights, fire alarm system, etc.), the facility may obtain a letter from its natural gas vendor to demonstrate the fuel source is reliable and meets the requirements for an on-site backup power source.

This is not the only method to meet the requirements. A facility with a natural gas generator may use other means to meet the requirements for an on-site backup power source that do not require a letter from its natural gas vendor.

The letter of reliability from the vendor must contain all of the following:

1. A statement of reasonable reliability of the natural gas delivery
2. A brief description that supports the statement regarding the reliability
3. A statement that there is a low probability of interruption of the natural gas
4. A brief description that supports the statement regarding the low probability of interruption
5. The signature of technical personnel from the natural gas vendor.

**Important:** *This impacts all nursing facilities that utilize a natural gas generator for back-up power to any LSC required system. It is not limited to facilities that have patients on life support, although it is required for them as well.*

The Kansas State Fire Marshal's Office is encouraging everyone to review their back-up power source to ensure they meet the requirements. Facilities need to start preparing now so they are not caught-up in time constraints down the road.

# FIRE

Kansas State Fire Marshal Prevention Divisions

---

**FIRE FACT NO. 66 CHECKLISTS(s):**

**TITLE: FIRESTOPPING**

**CHECKLIST ITEM(s):**

**REFERENCE(s): International Building Code 2006**

**PAGE: 1 of 3**

---

# FACT 066 FIRESTOPPING

In building construction, a rated wall is designed to subdivide a building into separate fire areas in an effort to slow the spread of fire or smoke from one side of the building to the other. These walls are designed to maintain a specific fire rating in accordance with all applicable building codes.

There are various types of rated walls that are present in almost every building type. The International Building Codes provides the following definitions:

*Fire Wall: A fire-resistance-rated wall having protected openings, which restricts the spread of fire and extends continuously from the foundation to or through the roof, with sufficient structural stability under fire conditions to allow collapse of construction on either side without collapse of the wall.*

*Fire Barrier: A fire-resistance-rated wall assembly of materials designed to restrict the spread of fire in which continuity is maintained.*

*Smoke Barrier: A continuous membrane, either vertical or horizontal, such as a wall, floor, ceiling assembly that is designed and constructed to resist the movement of smoke.*

These rated walls are originally designed to be a continuous solid barrier. Additionally, a fire wall is specifically required to be continuous from exterior wall to exterior wall and begins at the foundation and extends to a distance above the roof. Rated walls are also required to be continuous through all concealed spaces unless the construction assembly forming the bottom of the space has a fire rating equal to that of the rated wall.

Over time, as building occupancy changes, technology advances, and buildings undergo renovation, there becomes a need for the facility to penetrate these rated walls with cables, piping, duct work, etc. These penetrations, any penetration, are required to be adequately firestopped in order to maintain the rating of the wall.

*Firestopping: A precisely tested means and method for preventing the spread of fire (and to a lesser degree smoke) through a breach or gap in a fire-resistance rated wall.*

The Kansas State Fire Marshal's Office highly recommends that facilities consult with a specialist or an engineer to obtain an engineering judgement and/or recommendation for a qualified contractor to perform the work. Firestopping should not be considered standard building maintenance.

The installation of firestopping materials is very technical and must be installed in accordance with the manufacturers' guidelines, otherwise the firestopping product will not be effective and the rated wall will not function as designed. Facilities must do extensive research into firestopping before attempting to correct any rated wall penetration. Listed below are the steps each facility must take in order to ensure proper firestopping.

1.) *Choose a single firestopping manufacturer*

Facilities should stick with the same firestopping manufacturer throughout an entire rated wall assembly. Firestopping manufacturers only pay for their products to be tested. Company A is not paying for their product to be tested along with Company B product. Ideally facilities should have the same firestopping manufacturer throughout the entire facility.

**Kansas State Fire Marshal Prevention Divisions**

**FIRE FACT NO. 66 CHECKLISTS(s):**

**TITLE: FIRESTOPPING**

**CHECKLIST ITEM(s):**

**REFERENCE(s): International Building Code 2006**

**PAGE: 2 of 3**

2.) *Establish a fire system assembly*

A fire system assembly is similar to a pre-established product line. It's a group of firestopping materials that have been tested together for various penetration types and still maintain the rating. Once a facility chooses a fire system assembly they must stick with that assembly from that point forward for any new or inadequate penetrations.

3.) *Read and understand the requirements*



The fire system assembly contains the very specific installation instructions. Without the fire system assembly there is no way for a facility or contractor to know how the firestopping product is to be installed.

4.) *Install according to manufacturer*


Firestopping is tested under very precise conditions. If the firestopping is not installed appropriately then it will not function as intended and the fire wall may not provide the separation necessary to allow occupants time to evacuate. Installation includes, but is not limited to: using the appropriate amount of product; the product is uniform and covers 360° around the penetrant; and the firestopping product is adequately tooled\*.

Please review the following basic installation requirements:

*Tooling: the final step in firestopping which insures an appropriate amount of product is pushed down and into the annular space and that the product adheres to both the penetrating item and the wall/floor surface.*

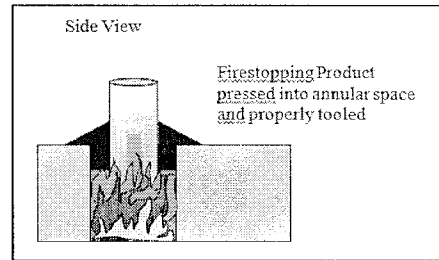

*Rated Wall Band-Aids: the method of overlaying a piece of drywall to the original drywall rated wall in order to cover a large hole or to reduce the annular space around a penetration for firestopping purposes.*

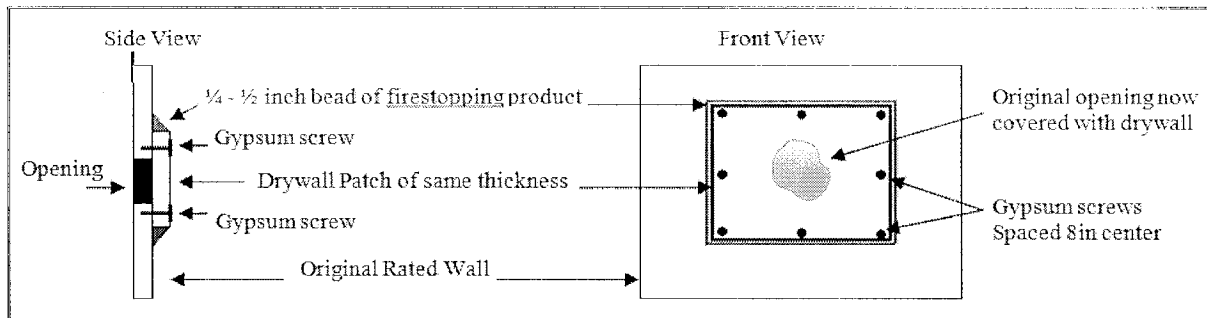

## Kansas State Fire Marshal Prevention Divisions

### FIRE FACT NO. 66 CHECKLISTS(s):

#### TITLE: FIRESTOPPING

#### CHECKLIST ITEM(s):

#### REFERENCE(s): International Building Code 2006

#### PAGE: 3 of 3

The Kansas State Fire Marshal's Office will continue to cite any facility whose current firestopping installation looks inadequate. If a facility is cited for an inadequate existing or new penetration, they must submit documentation regarding the firestopping product and the fire system assembly. For existing inadequate penetrations, facilities must completely remove the old product and start over.

Example of Fire System Assembly:

**System No. XXXX**  
F Rating — 2 Hr  
T Ratings — 0, 1-1/4 and 2 Hr (See Item 2)  
L Rating At Ambient — Less Than 1 CFM/sq ft  
L Rating At 400 F — 4 CFM/sq ft

1. Floor or Wall Assembly — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m<sup>3</sup>) concrete floor or min 5 in. (127 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m<sup>3</sup>) concrete wall. Wall may also be constructed of any UL Classified Concrete Blocks\*. Floor may also be constructed of any 6 in. thick UL Classified hollow core Precast Concrete Units. Max diam of opening is 4 in. (102 mm).  
See Concrete Blocks (CAZT) and Precast Concrete Units\* (CFTV) categories in the Fire Resistance Directory for names of manufacturers.

2. Steel Sleeve — (Optional) Nom 4 in. (102 mm) diam (or smaller) Schedule 40 (or heavier) steel pipe cast or grouted into floor or wall assembly, flush with floor or wall surfaces or extend a max 3 in. (76 mm) above the floor or beyond both surfaces of the wall. The T Rating for the firestop system is 2 hr except that when the steel sleeve is provided. If the steel sleeve is installed flush with both surfaces of the floor or wall, the T Rating of the firestop system is 1-1/4 hr. If the steel sleeve extends beyond the top surface of the floor or both surfaces of the wall, the T Rating of the firestop system is 0 hr.

3. Through Penetrants — One nonmetallic pipe to be installed either concentrically or eccentrically within the firestop system. The annular space between pipe and sleeve (Item 2) shall be min 1/4 in. (6 mm) to max 1-3/8 in. (35 mm). When steel sleeve (Item 2) is not provided, the annular space between pipe and periphery of opening shall be min 0 in. (point contact) to max 1-5/8 in. (44 mm). Pipe to be rigidly supported on both sides of floor or wall assembly. The following types and sizes of nonmetallic pipes may be used:

- A. Polyvinyl Chloride (PVC) Pipe — Nom 2 in. (51 mm) diam (or smaller) Schedule 40 solid-core or cellular core PVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping system.
- B. Chlorinated Polyvinyl Chloride (CPVC) Pipe — Nom 2 in. (51 mm) diam (or smaller) SDR17 CPVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.
- C. Rigid Nonmetallic Conduit — Nom 2 in. (51 mm) diam (or smaller) Schedule 40 PVC conduit installed in accordance with Article 347 of the National Electrical Code (NFPA 70).
- D. Crosslinked Polyethylene (PEX) Tubing — Nom 2 in. (51 mm) diam (or smaller) SDR 9 PEX tubing for use in closed (process or supply) piping systems.

4. Firestop System — The firestop system shall consist of the following:

- A. Packing Material — Min 4 in. (102 mm) thickness of min 4 pcf (64 kg/m<sup>3</sup>) mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor or both surfaces of wall to accommodate the required thickness of fill material. When precast concrete units are used, packing material to be recessed from top surface of floor to accommodate the required thickness of fill material and to be installed flush with bottom surface of floor.
- B. Fill, Void or Cavity Material — Sealant — Min 1/2 in. (13 mm) thickness of fill material applied within the annulus, flush with top surface of floor or both surfaces of wall assembly. Additionally, nom 1/2 in. (13 mm) bead of fill material applied between concrete and penetrant interface.